




SLD OF 66KV G/S/STN. PHASE-1 CHANDIGARH

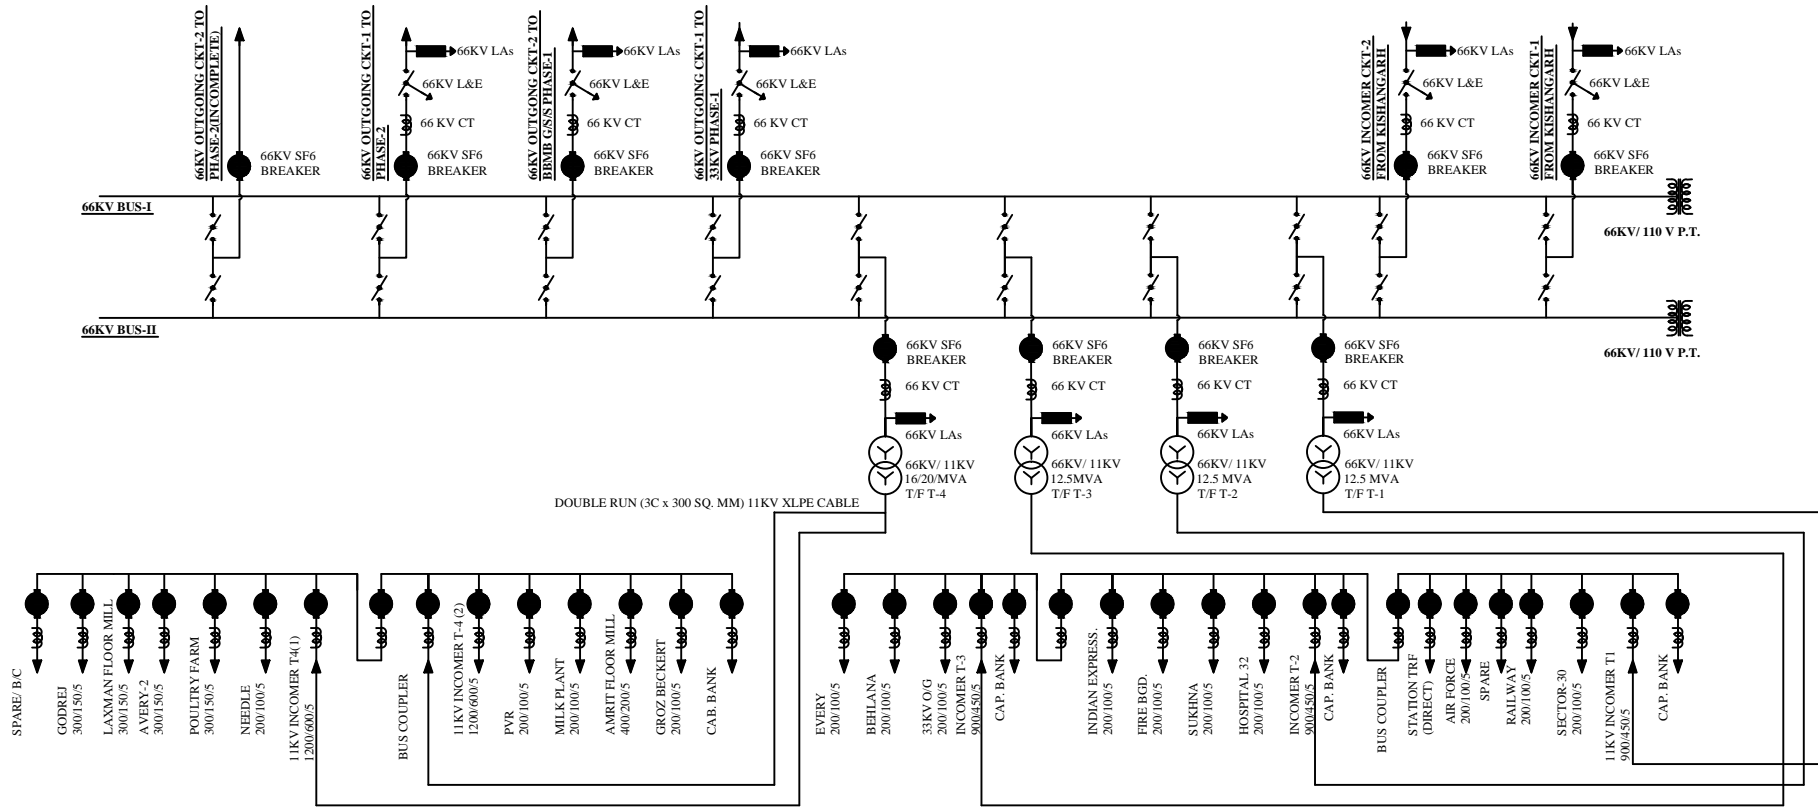


SLD OF 66KV G/S/STN. PHASE-2 CHANDIGARH

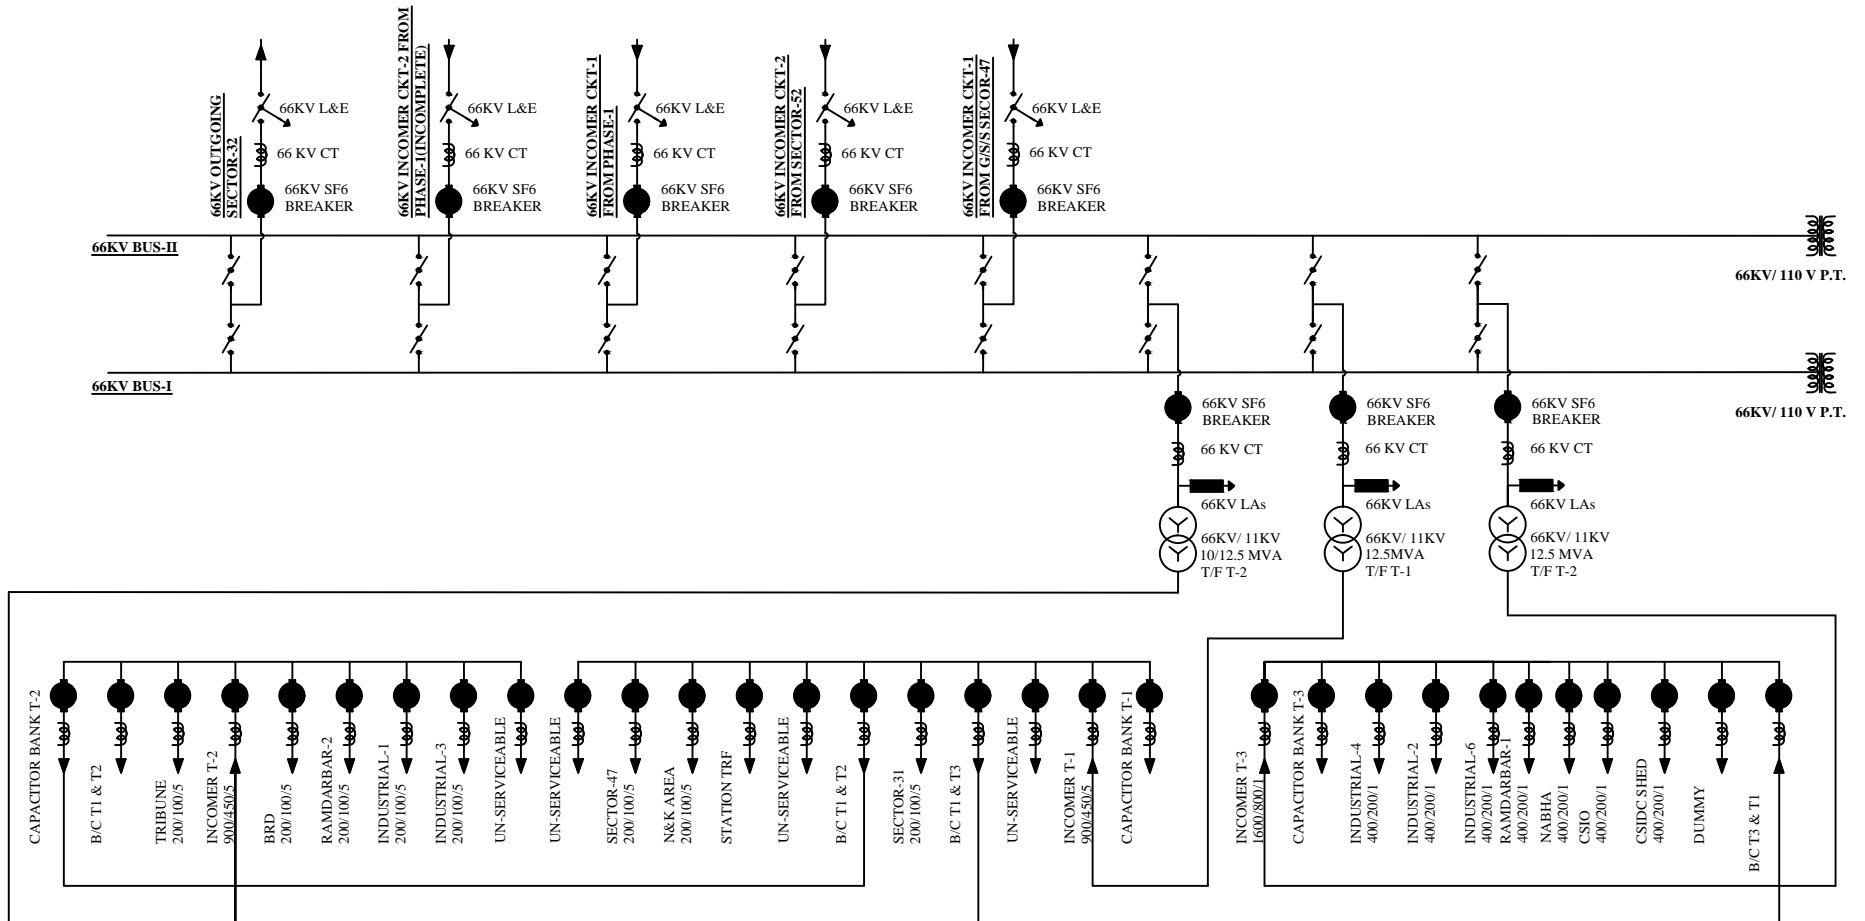

SLD OF 66KV G/S/STN. SECTOR-47 CHANDIGARH

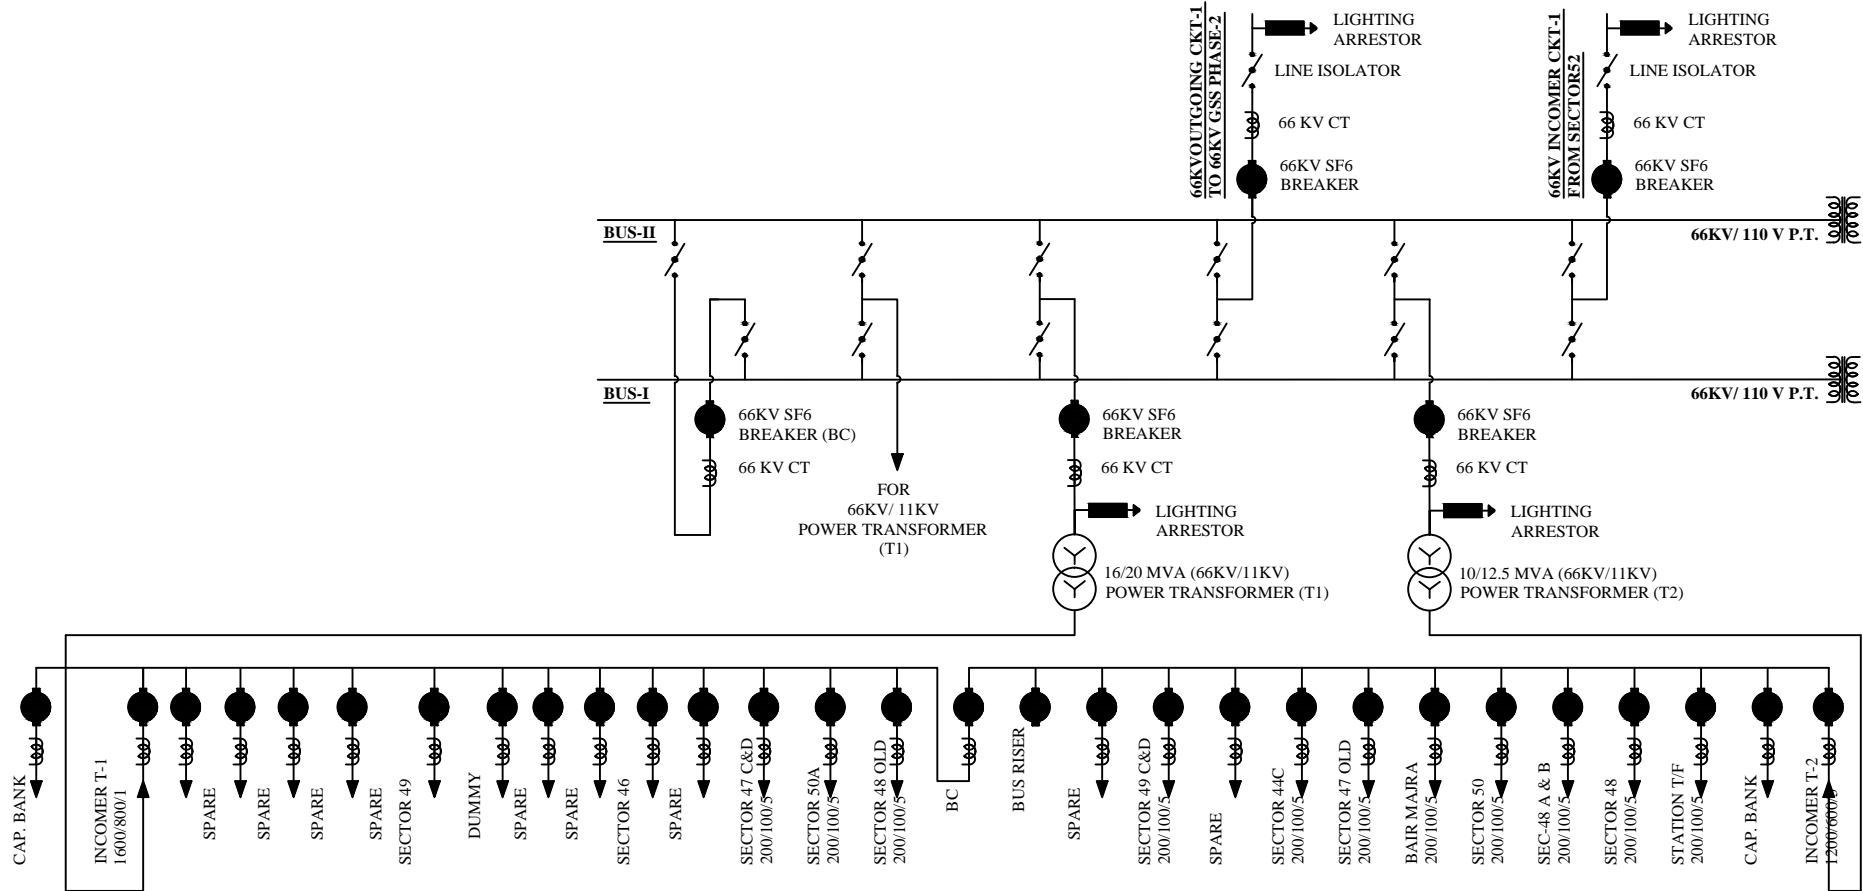

33 KV GRID S/STN. INDL. AREA, PH-I, CHD.

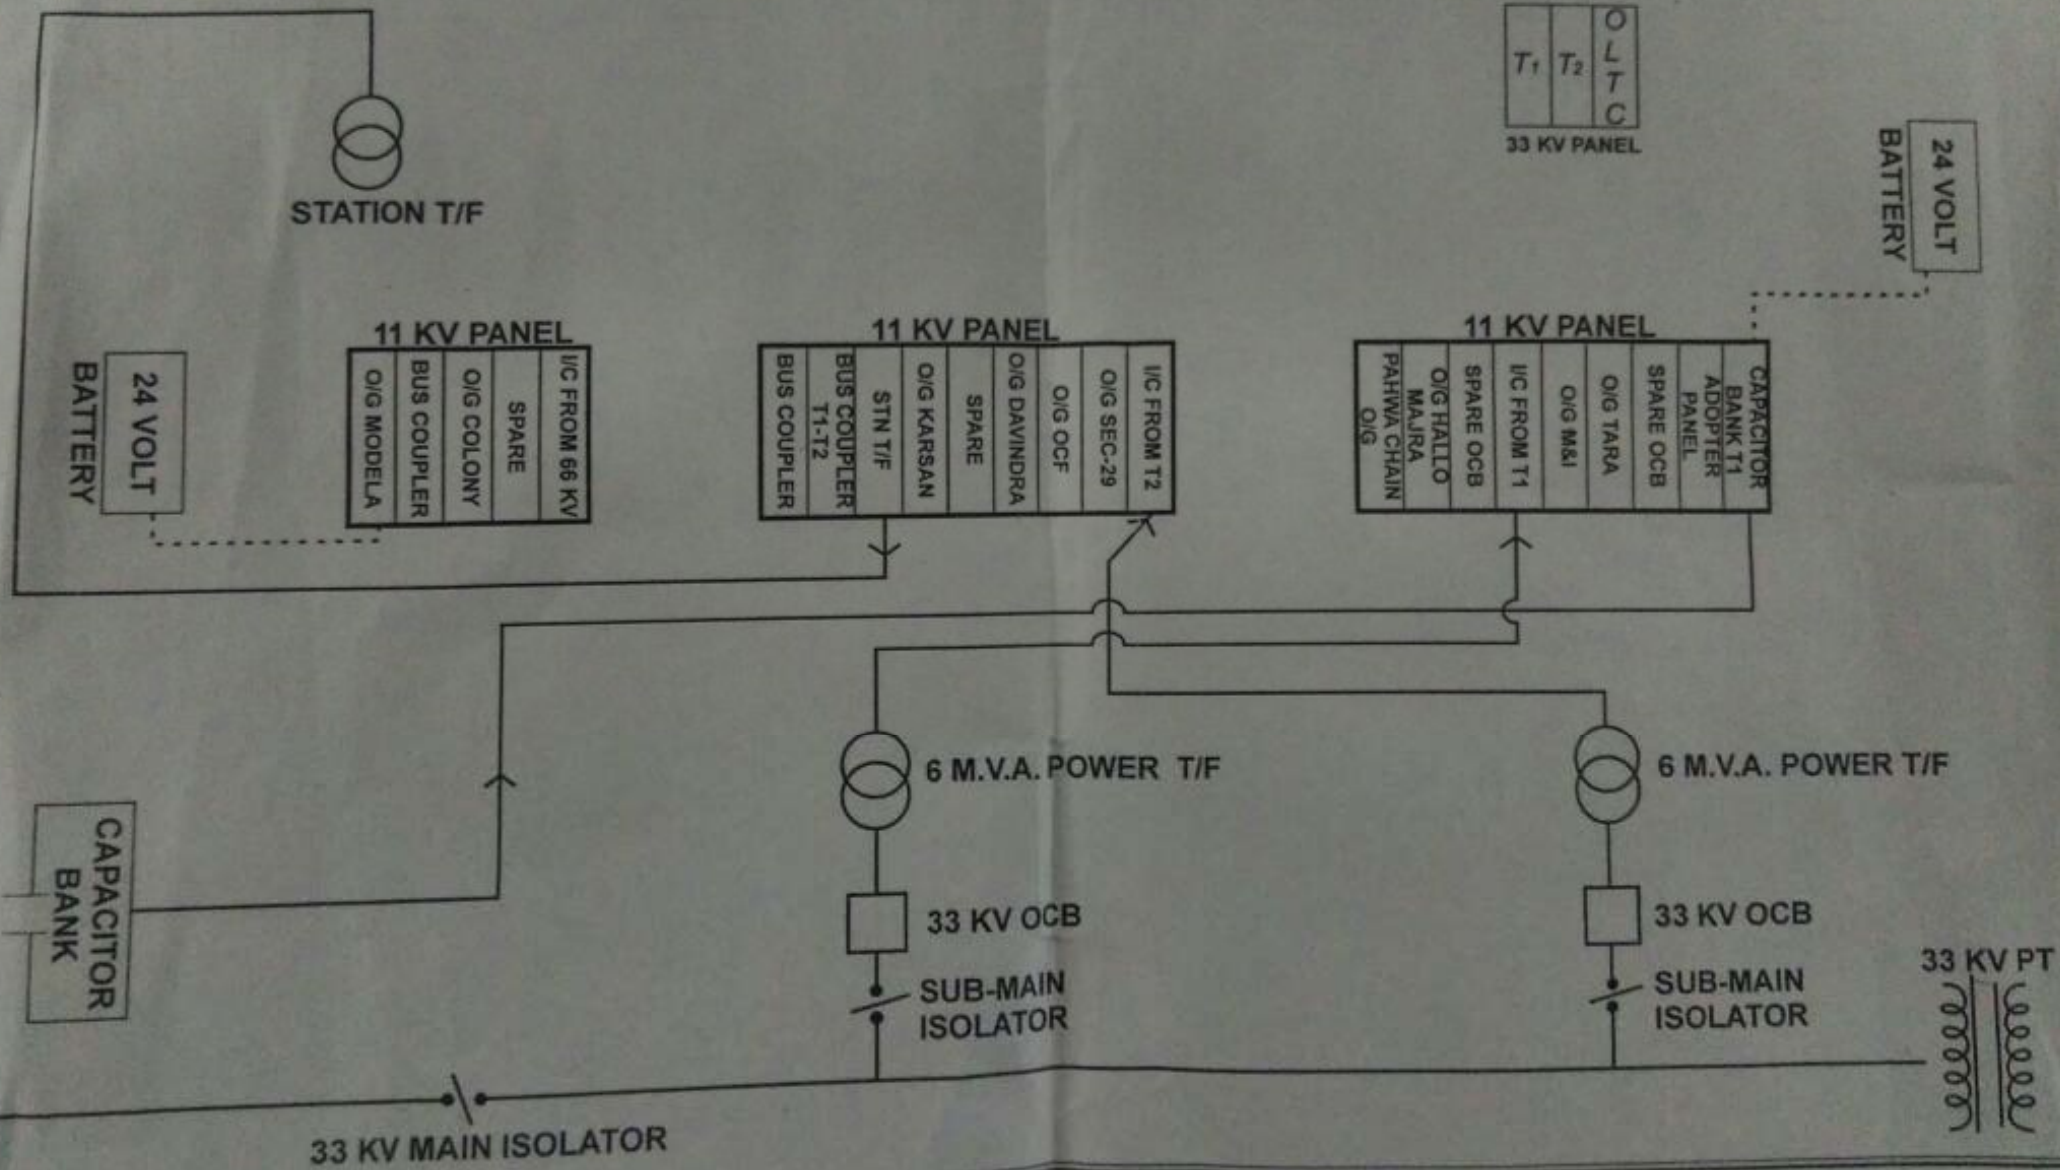

T ₁	T ₂	O
		L
		T
		C

33 KV PANEL

24 VOLT
BATTERY

11 KV PANEL

I/C FROM 66 KV
SPARE
O/G COLONY
BUS COUPLER
O/G MODELA

11 KV PANEL

I/C FROM T2
O/G SEC-29
O/G OCF
O/G DAVINDRA
SPARE
O/G KARSAN
STN T/F
BUS COUPLER T1-T2
BUS COUPLER

11 KV PANEL

CAPACITOR BANK T1
ADAPTER PANEL
SPARE OCB
O/G TARA
O/G M&I
I/C FROM T1
SPARE OCB
O/G HALLO MAJRA
PAHWIA CHAIN O/G

24 VOLT
BATTERY

CAPACITOR BANK


33 KV MAIN ISOLATOR

6 M.V.A. POWER T/F
33 KV OCB
SUB-MAIN ISOLATOR

6 M.V.A. POWER T/F
33 KV OCB
SUB-MAIN ISOLATOR

33 KV PT

66 KV SEC-32 KEY DIAGRAM

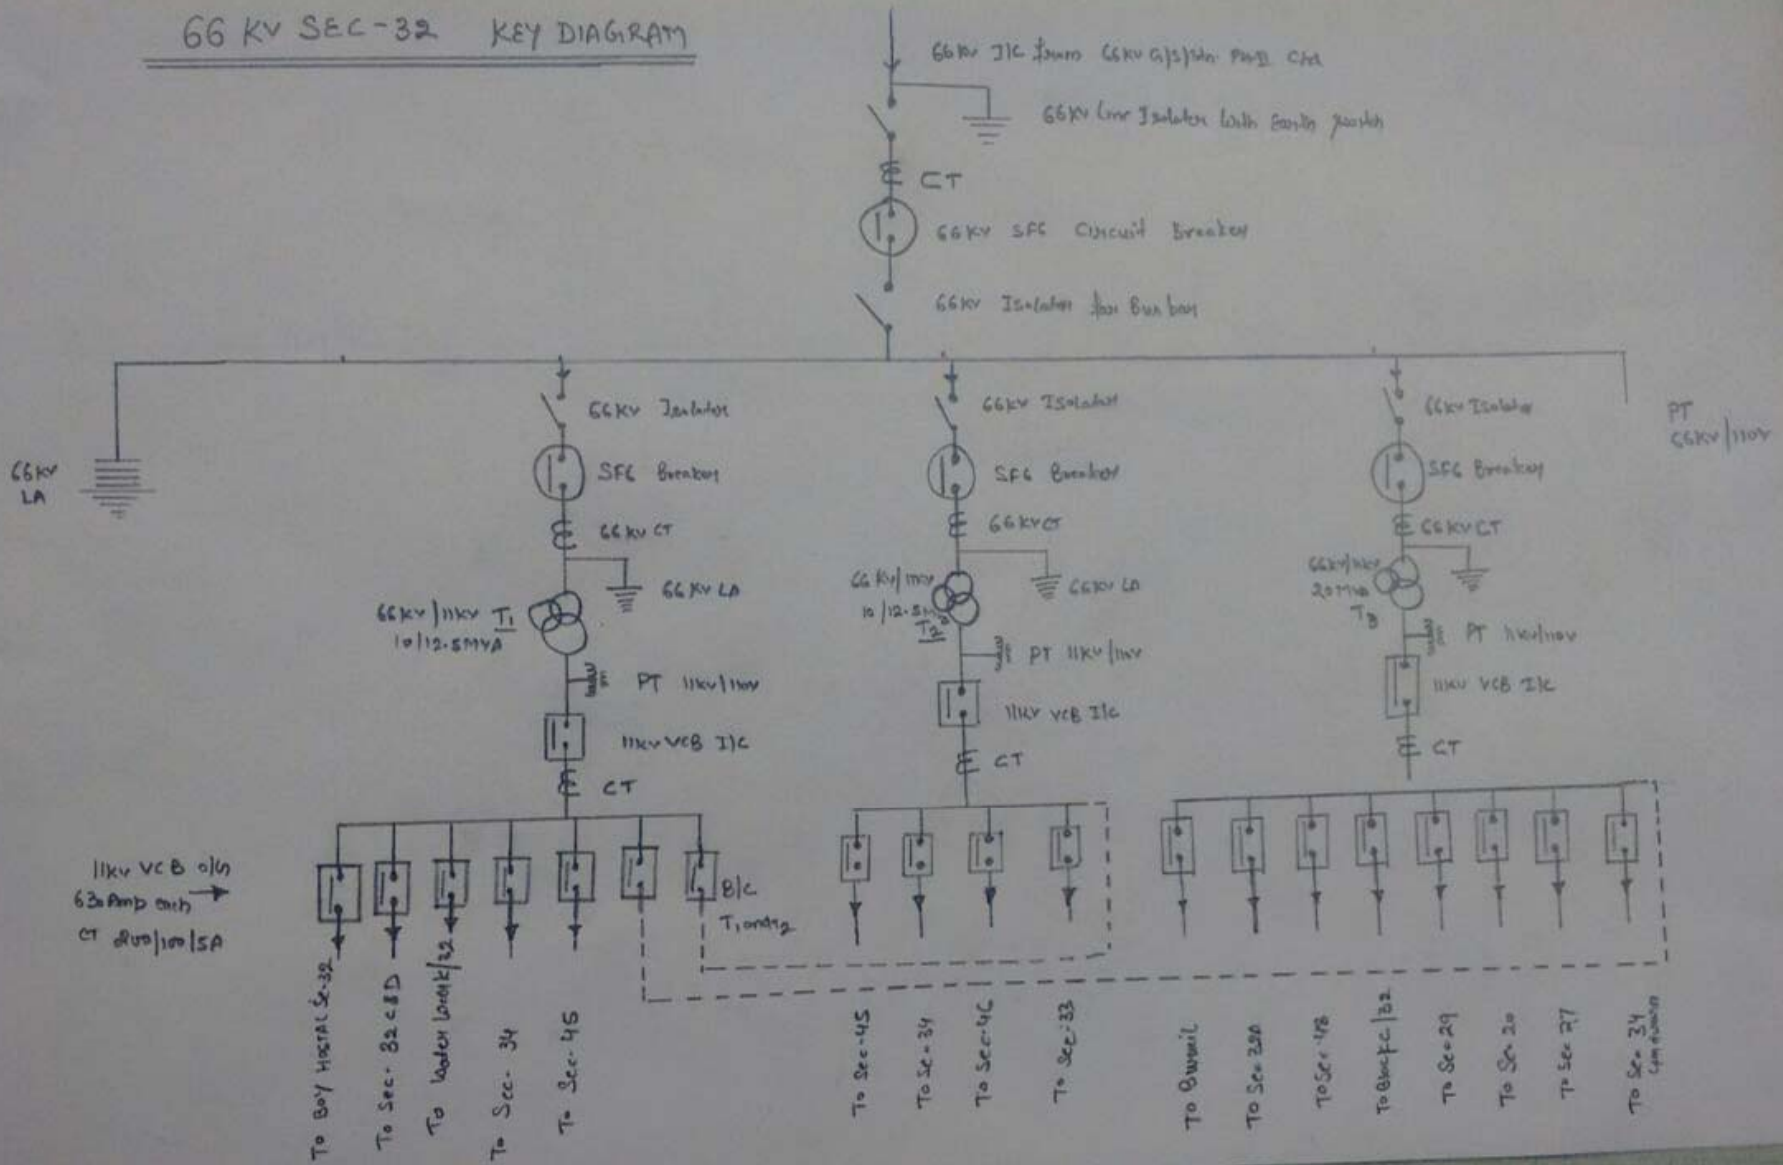

KEY DIAGRAM-66KV GSS BBMB CHANDIGARH

